

specifications

The medical gas Retro-Fit outlet shall be an Amico Alert-1 series.

Outlets shall be equipped with a primary and secondary check valve for positive pressure for gas services. The secondary check valve shall be rated at a maximum of 200 psi [1,379 kPa] in the event the primary check valve is removed for maintenance. Outlet bodies shall be gas specific by indexing each gas service to a gas specific single pin indexing arrangement on the respective identification module.

A large color coded front plate shall be used for ease of gas identification and aesthetic appeal.

A one piece chrome trim plate shall frame the outlet.

The latch-valve assembly shall be Ohmeda Diamond™ Quick Disconnect or DISS depending on the type ordered.


Amico products comply with NFPA-99.



features

- ▶ Flow rate exceeds the requirements of NFPA and CSA
- ▶ 100 % Hydrostatic testing of each outlet and cleaned for medical gas service
- ▶ Indexed to eliminate interchangeability of gas services
- ▶ Universal rough-in assembly to accept Quick Connects or DISS front adapters (Can be interchanged at any time)

project

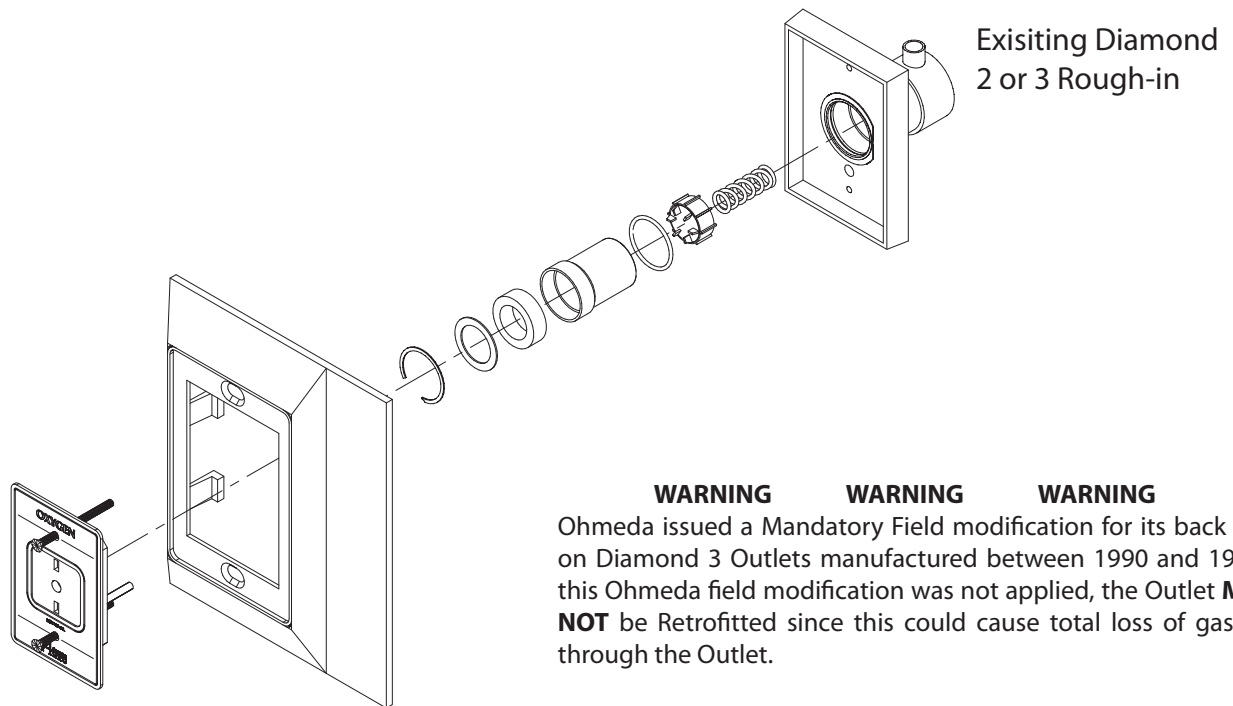

Existing Diamond 2 or 3 Rough-in

WARNING WARNING WARNING


Ohmeda issued a Mandatory Field modification for its back body on Diamond 3 Outlets manufactured between 1990 and 1993. If this Ohmeda field modification was not applied, the Outlet **MUST NOT** be Retrofitted since this could cause total loss of gas flow through the Outlet.

¹NOTE: Suction inlets are not supplied with a secondary check valve. A pressure plug is provided for testing purposes, rated at 150 psi [1,034 kPa].

model numbers

Complete Conversion Kit:

O-OH2-XX-L-X-S

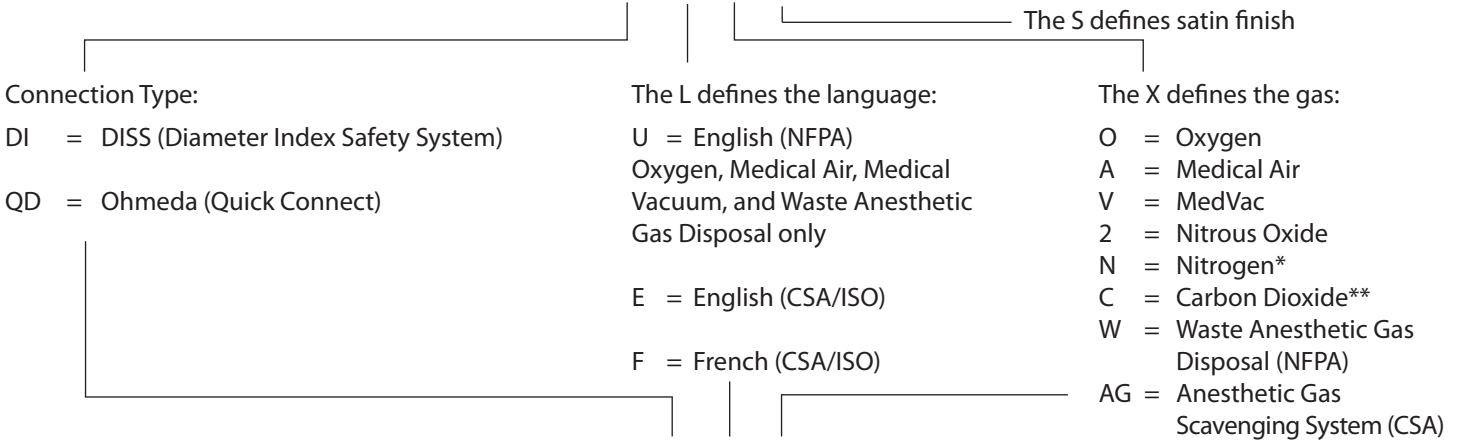

When using existing rough-in parts: **O-OH2-XX-L-X-PP**

- * Available in DISS connection type only
- ** Available in Ohmeda and DISS connection types only

Plug and play

represented by: